


MULTIPLE BOILER PIPING REVERSE RETURN

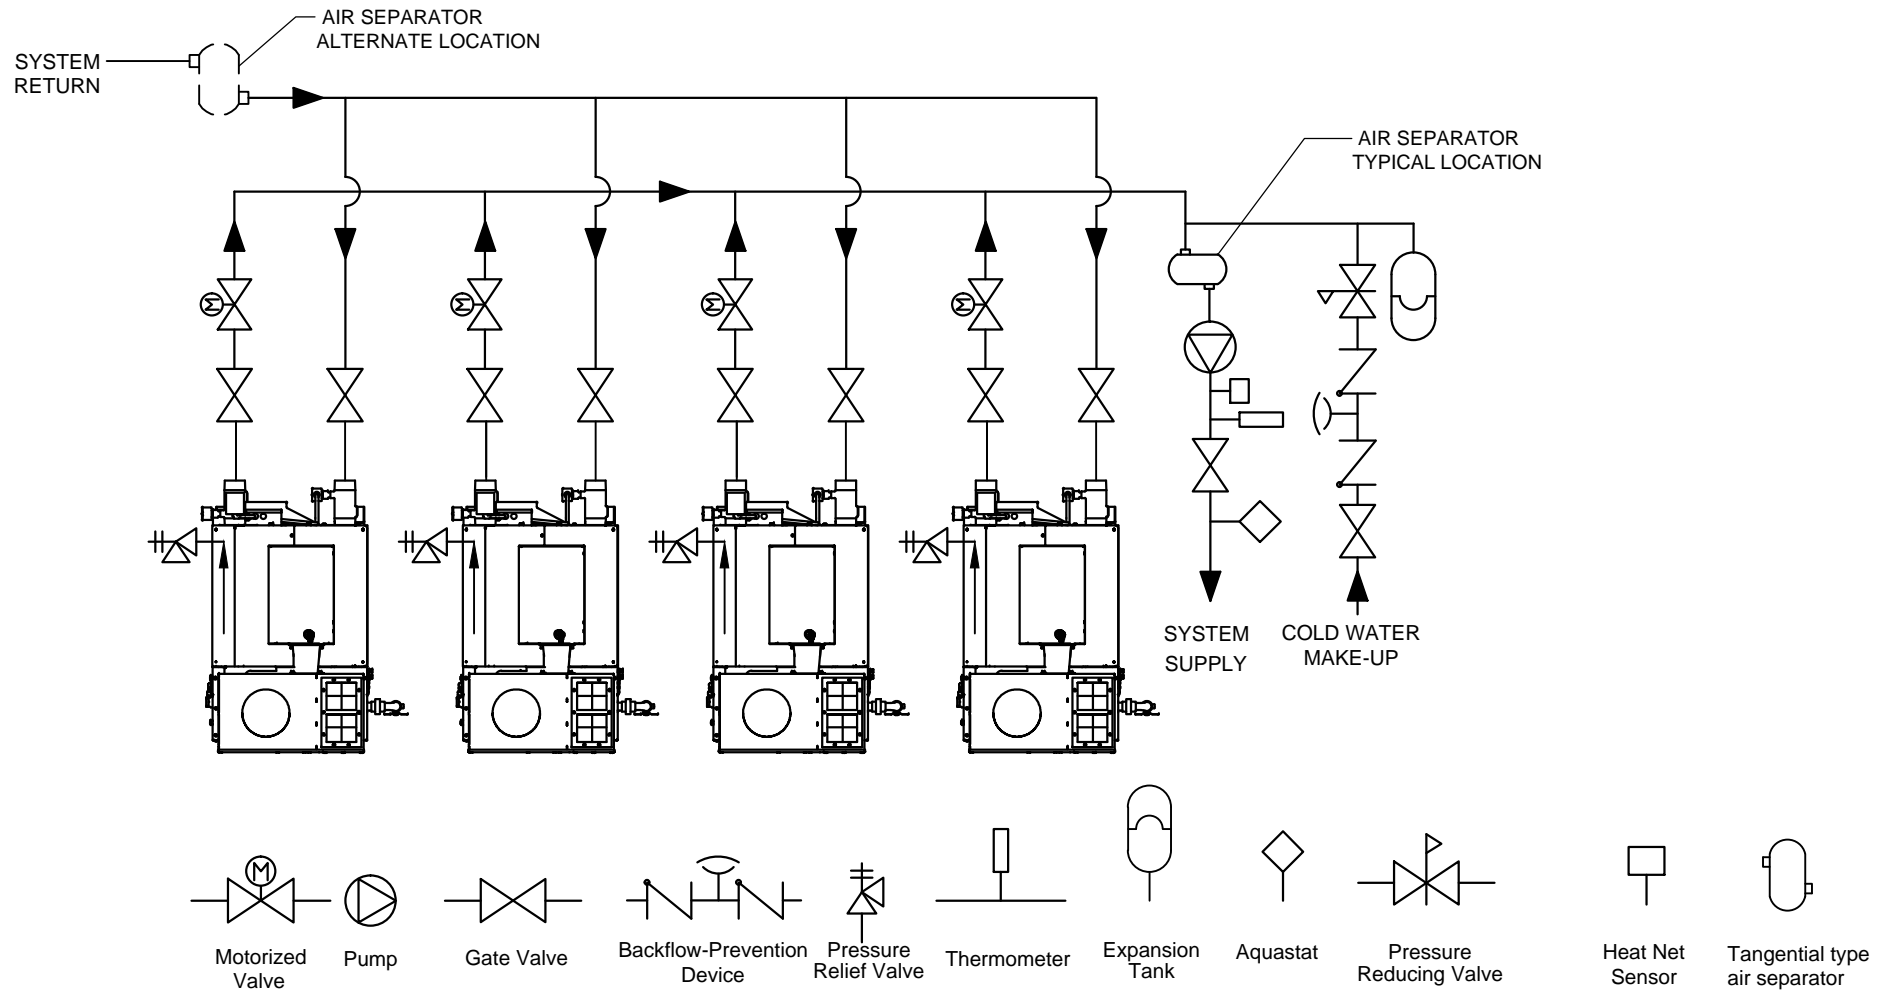

HIOM-11-REV.5

For Heat-Net operation, a sensor is required and installed at a minimum of 12" from primary loop tee.