


SINGLE BOILER PIPING PRIMARY/SECONDARY

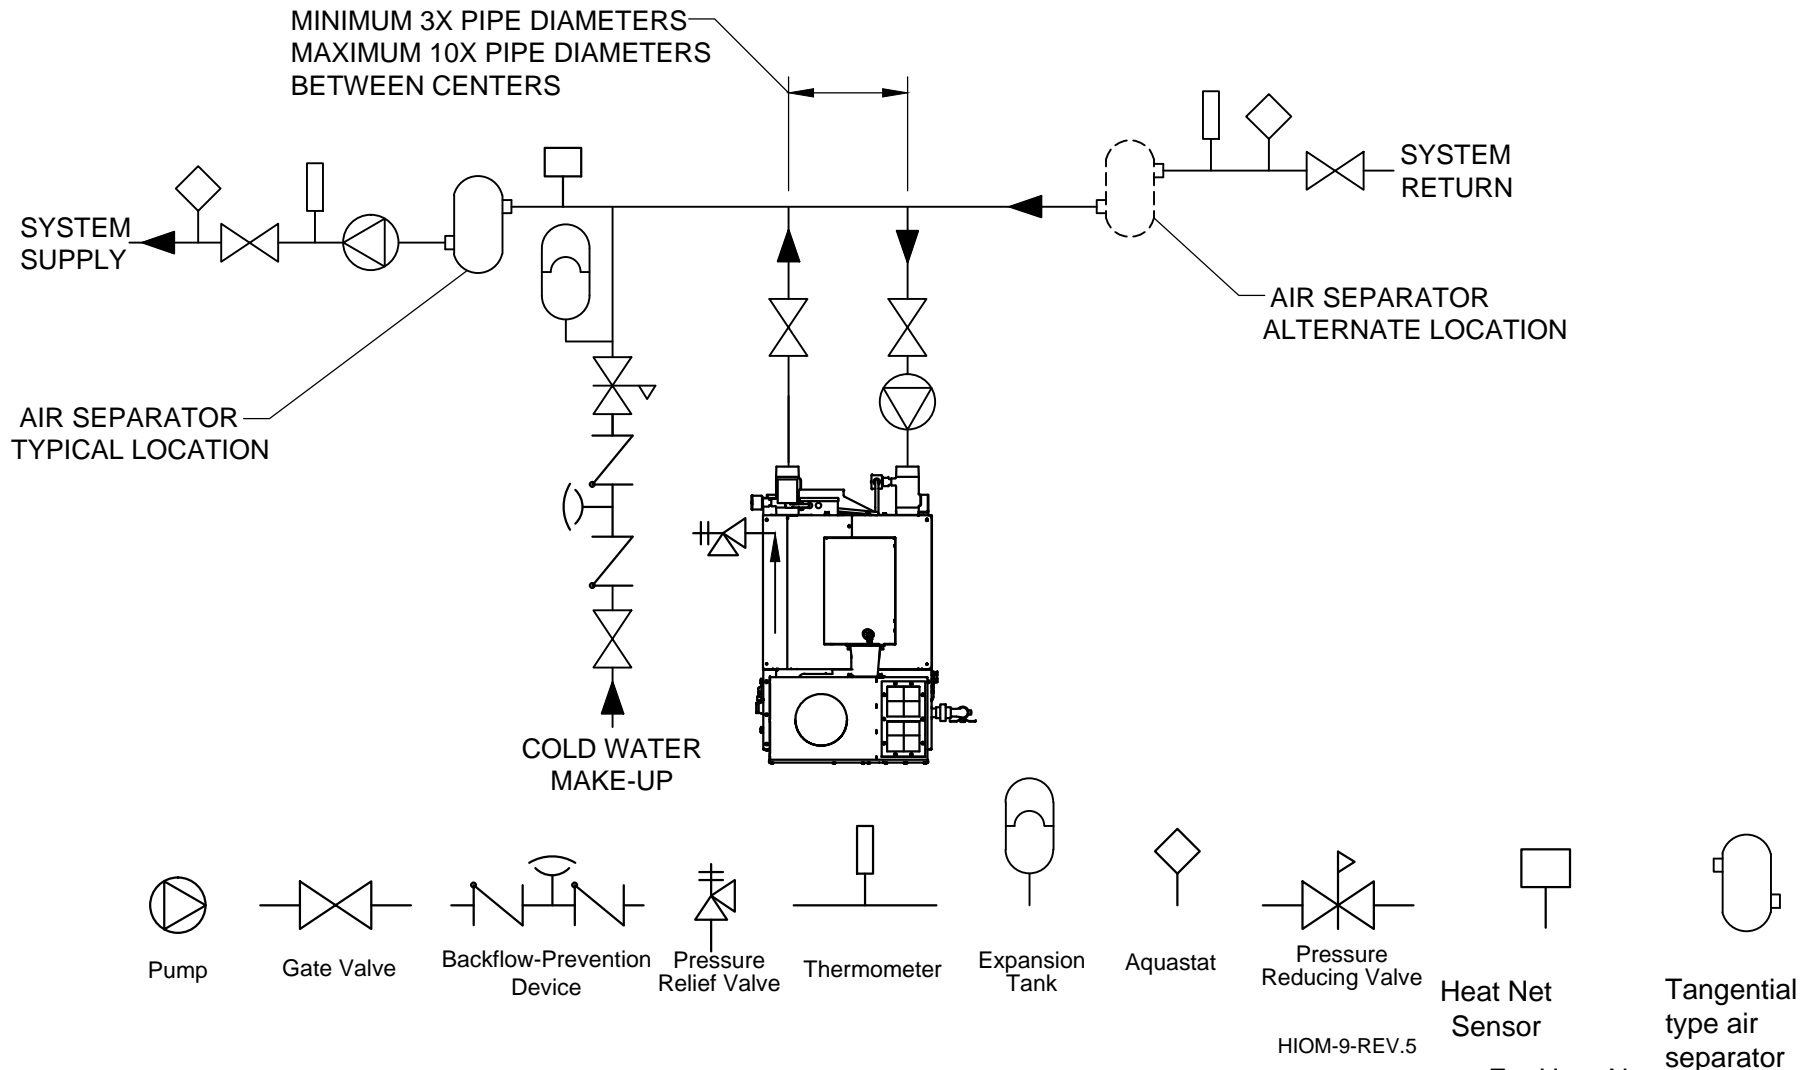

For Heat-Net operation, a sensor is required and installed at a minimum of 12" from primary loop tee.