
FlexCore 2000

CODE OPTIONS

Category II or Category IV Appliance (see Installation and Operation Manual for venting information)

CSD-1 STANDARD

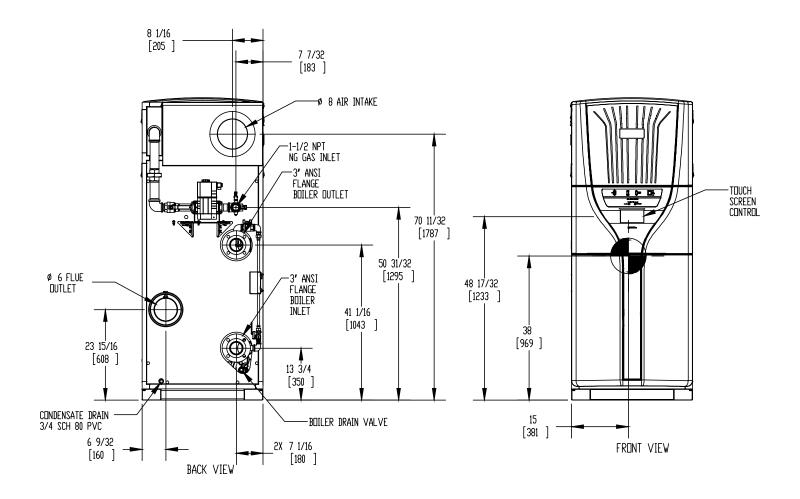


- Notes:
 1. Dimensions are approximate and should not be used to "rough-in" equipment.
 2. Dimensions are subject to change without notice.


- All dimensions are in inches (mm).
 Symbol indicates center of gravity.


CSD-1 STANDARD

Category II or Category IV Appliance

(see Installation and Operation Manual for venting information)

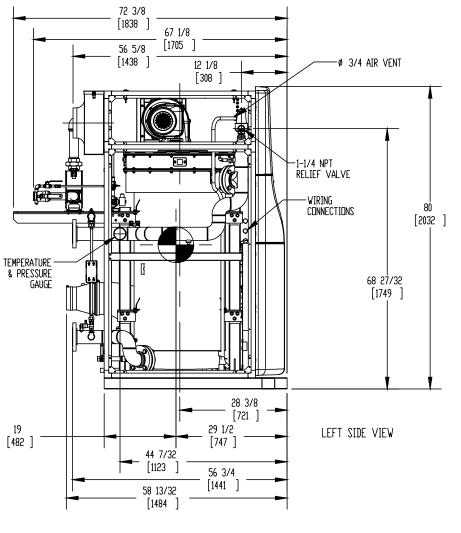

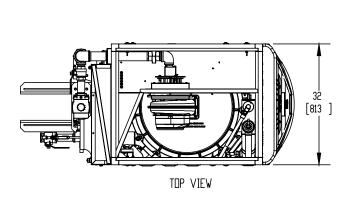

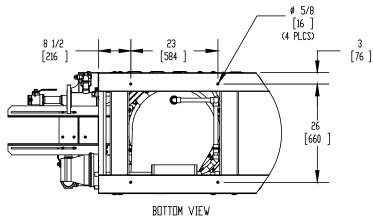

BOILER CERTIFIED RATINGS & CAPACITIES

Fuel Type	Natural Gas	Boiler FLA	12.7*
Input BTU/hr.	1,999,000 / 586 KW	Boiler HP	56.8
Output BTU/hr.	1,901,049 / 557KW	Min. Gas Pressure Required	3" W.C.
Electrical Requirements	230 VAC/60 Hz/1PH	Max. Gas Pressure Allowed	14" W.C.
	(with neutral)	Operating Weight	2290 lbs. / 1039 kg.

BOILER TRIM & CONTROLS

Main Gas Valve	Dungs MBC	Air Switch	Huba
Firing Valve	1 1/2" Apollo	Flow Sensor	SIKA
Ignition Control	Honeywell RM7895C	Blocked Flue Switch	Cleveland NS2
Operating Control	HeatNet [®]	Blower Motor	Ametek
High Limit	Jumo	L.W.C.O.	800
Main Ball Valve	1 1/2" Apollo	Relief Valve	1" x 1-1/4" set @ 50 psi
Pilot Cock	1/4"	Pilot Regulator	White-Rodgers

A.S.M.E.

ASME Sect IV Fire Side	168 Sq. Ft. / 15.6 Sq. M.	Design Data	Max. 160 psig & 210°F
Htg Surface		Water Volume	62 gal / 234 liters
ASME Sect IV Water Side	174 Sq. Ft. / 16.2 Sq. M.		
Htg Surface			
CV. GPM (1PSID)	93		

^{*} Add circulator amps.

BOILER TEMPERATURE RISE / PRESSURE DROP (Based on Full Input)

	20°F /	11.1°C	;	40°F / 22.2°C		60°F / 33.3°C			80°F / 44.4°C				100°F / 55.5°C						
Flo Ra	ow ite		sure	Flo Ra	-		sure op	l .	ow ite		sure	Flo Ra	ow ite		sure	l .	ow ate		sure
GPM	L/s	Ft	kPa	GPM	L/s	Ft	kPa	GPM	L/s	Ft	kPa	GPM	L/s	Ft	kPa	GPM	L/s	Ft	kPa
190.2	12.0	9.6	28.8	95.1	6.0	2.4	7.2	63.4	4.0	1.1	3.2	47.5	3.0	0.6	1.8	38.0	2.4	0.4	1.2

Flow	GPM	Temp. Ri	se** (°F)	Vent Length	n (Equiv. Ft.)	Air Inlet Length (Equiv. Ft.)		
Min	Max	Min	Max	Min	Max	Min Max		
38.0	190.2	20	100	6	100	0	100	

^{**} Min/Max delta t reflects boiler operation at full input. For applications requiring operation above/below these parameters please consult factory.

REP FIRM	
SUBMITTED BY	
JOB NAME	
ARCHITECT	
ENGINEER	
CONTRACTOR	
DATE	

FlexCore 2000

Category II or Category IV Appliance

(see Installation and Operation Manual for venting information)



A Division of Mestek, Inc. Westfield, MA 01085 (413) 564-5515