# **TORUS 4000 VERTICAL**

Category II or Category IV Appliance


(see Installation and Operation Manual for venting information)

#### **CODE OPTIONS**

CSD-1

FIRMWARE W/REMOTE TEST MANUAL RESET LWCO

# **INDOOR UNIT**

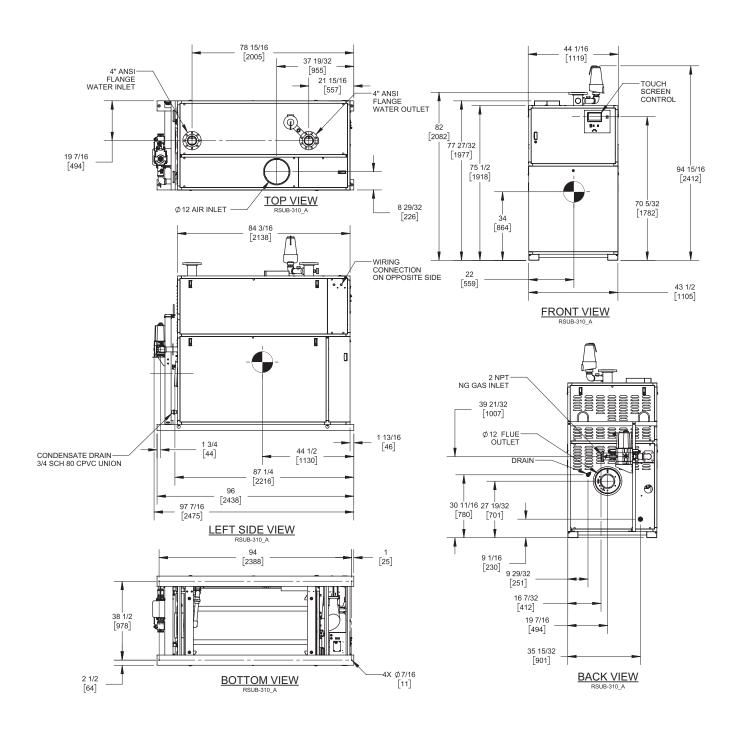

#### Notes:

- 1. Dimensions are approximate and should not be used to "rough-in" equipment.
- 2. Dimensions are subject to change without notice.
- 3. All dimensions are in inches (mm).
- Symbol indicates center of gravity.

# **TORUS 4000 VERTICAL**

**Category IV Appliance** 


(see Installation and Operation Manual for venting information)

#### **CODE OPTIONS**

CSD-1

FIRMWARE W/REMOTE TEST MANUAL RESET LWCO

# **DUAL FUEL UNIT**

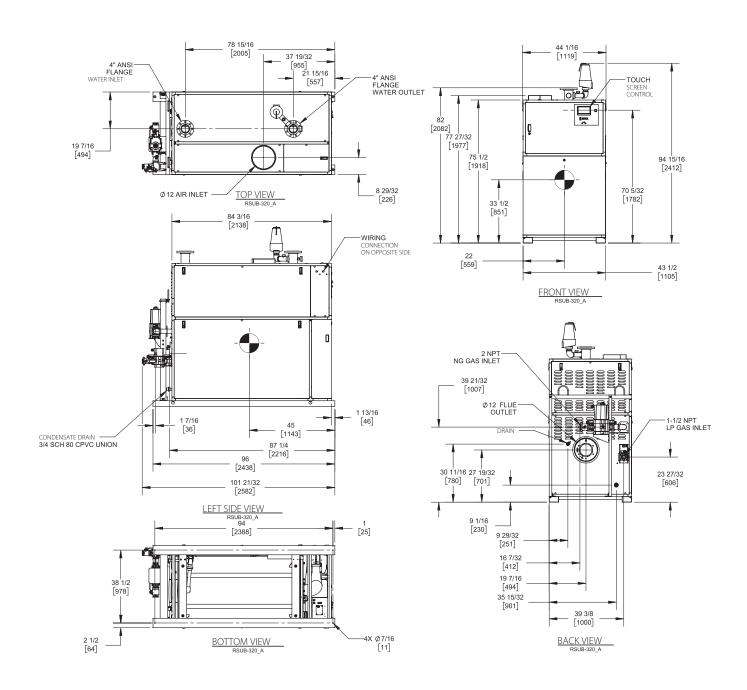

#### Notes:

- 1. Dimensions are approximate and should not be used to "rough-in" equipment.
- 2. Dimensions are subject to change without notice.
- 3. All dimensions are in inches (mm).
- Symbol indicates center of gravity.

### **BOILER CERTIFIED RATINGS & CAPACITIES**

Fuel Type	Natural/Propane Gas	Boiler FLA	19.9*
Input BTU/hr.	4,000,000 / 1172kW	Boiler HP	116.52
Output BTU/hr.	3,900,000 / 1143 kW	Min. Gas Pressure Required	4" W.C.
Electrical Requirements	230 VAC/60 Hz/3PH	Max. Gas Pressure Allowed	14" W.C.
		Operating Weight	2866 lbs / 1300 kg

### **BOILER TRIM & CONTROLS**

Main Gas Valve	Dungs MBC	Air Switch	Huba		
	9				
Firing Valve	2" Apollo	Flow Switch	SIKA		
Ignition Control	Fenwal	Blocked Flue Switch	Cleveland NS2		
Operating Control	HeatNet <sup>®</sup>	Blower Motor	Ametek		
High Limit Jumo		L.W.C.O.	800		
Main Ball Valve	2" Apollo	Relief Valve (WB)	1" x 1 1/2" set @ 50 psi		
Pump contactor strongly recommended	for water heater applications.	Relief Valve (WW)	1 1/2" x 1 1/2" set @ 125 psi		

### A.S.M.E.

ASME Sect IV Fire Side	402.93 Sq. Ft. / 37.43 Sq. M.	Design Data	Max. 160 psig & 210°F
Htg Surface		Water Volume	41.3 gal. / 156.3 Liters
ASME Sect IV Water Side	371.25 Sq. Ft. / 34.49 Sq. M.		
Htg Surface			

<sup>\*</sup> Add circulator amps.

### **BOILER TEMPERATURE RISE / PRESSURE DROP (Based on Full Input)**

	20°F /	11.1°C		30°F / 16.7°C			40°F / 22.2°C			50°F / 27.8°C				60°F / 33.3°C					
	ow ate		sure op		ow ate		sure op	1	ow ite		sure op	Flo Ra			sure op	Flo Ra	ow ite		sure
GPM	L/s	Ft	kPa	GPM	L/s	Ft	kPa	GPM	L/s	Ft	kPa	GPM	L/s	Ft	kPa	GPM	L/s	Ft	kPa
390.2	24.6	19.9	59.6	260.1	16.4	10.1	30.2	195.1	12.3	6.5	19.3	156.1	9.8	4.7	14.0	130.1	8.2	3.7	10.9

### WATER HEATER HOURLY RECOVERY CAPACITY (GPH & LPH)

40°F	22°C	60°F	33°C	80°F	44°C	100°F	56°C	120°F	67°C	140°F	78°C
11765	44471	7843	29647	5882	22235	4706	17788	3922	14824	3361	12706

Flow	GPM	Temp. Ris	se** (°F)	Vent Length	n (Equiv. Ft.)	Air Inlet Length (Equiv. Ft.)		
Min	Max	Min	Max	Min	Max	Min	Max	
130.1	390.2	20	60	12	160	0	160	

<sup>\*\*</sup> Min/Max delta t reflects boiler operation at full input. For applications requiring operation above/below these parameters please consult factory.

REP FIRM	
SUBMITTED BY	
JOB NAME	
ARCHITECT	
ENGINEER	
CONTRACTOR	
DATE	

# **TORUS 4000 VERTICAL**

## Category II or Category IV Appliance

(see Installation and Operation Manual for venting information)



A Division of Mestek, Inc. Westfield, MA 01085 (413) 564-5515