


RBI FLEXCORE 850 BOILER SEISMIC ANCHORAGE (ASCE 7-10)
Slab on Grade Applications Only

Equipment Parameters:

weight, $W_p = 1655.00$ LBS.
 $w = 32.000$ in.
 $L = 48.375$ in.
 $h = 79.500$ in.
 $cg = 37.562$ in.

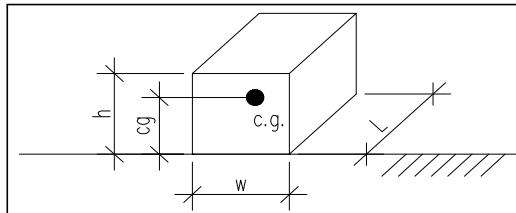

Seismic Parameters:

$S_s = 1.798$ (ASCE 7-10 Figure 22-1) Site Class =
 $a_p = 1.000$ (ASCE 7-10 Table 13.6-1)
 $I_p = 1.500$ (ASCE 7-10 13.1.3) Risk Category =

$R_p = 2.500$ (Default value for Anchorage per ASCE 7-10 Table 13.6-1)
 $F_a = 1.000$ (ASCE 7-10 Table 11.4-1)
 $S_{MS} = F_a * S_s = 1.798$ (ASCE 7-10 Eqn. 11.4-1)
 $S_{DS} = 2/3 * S_{MS} = 1.199$ (ASCE 7-10 Eqn. 11.4-3)

Seismic Design Category =

Seismic Force:

$F_p = (0.4 * a_p * S_{DS} * W_p) / (R_p / I_p) = 476.1$ LBS. (ASCE 7-10 Eqn. 13.3-1)
 Upper Limit: $F_{pMAX} = 1.6 * S_{DS} * I_p * W_p = 4761.1$ LBS. (ASCE 7-10 Eqn. 13.3-2)
 Lower Bound: $F_{pMIN} = 0.3 * S_{DS} * I_p * W_p = 892.7$ LBS. (ASCE 7-10 Eqn. 13.3-3)
 $F_{p, DESIGN} = 892.7$ LBS.


RBI FLEXCORE 850 BOILER SEISMIC ANCHORAGE (ASCE 7-10)

Design Anchorage Force:

Horizontal Shear Force Per Anchor:

$$R_H = F_p/4 = \boxed{223.2} \text{ LBS.}$$

Overturning Resistance About Point A:

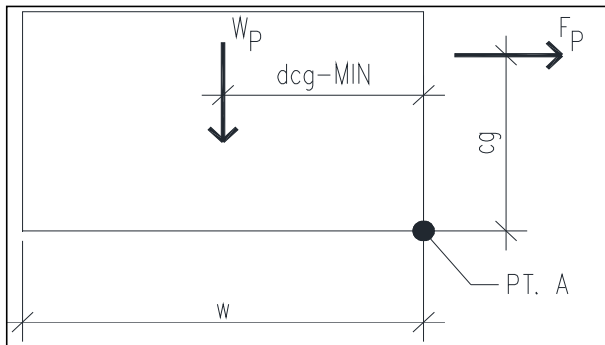

$$x = \boxed{32.00} \text{ in.}$$

$x = \text{lesser of } L \text{ or } W$
 $d_{cg} - \text{Min} = \boxed{14.968} \text{ in.}$

$$M_{OT} = F_p * c_g = \boxed{2794.3} \text{ LBS.-FT.}$$

$$M_{RES} = W_p * d_{cg-MIN} = \boxed{1032.2} \text{ LBS.-FT. Uplift}$$

Vertical Acceleration: assume $\rho = 1.0$

$$E_v = \rho * F_p + 0.2 * S_{DS} * W = \boxed{619.9} \text{ LBS. (ASCE Section 13.3.1)}$$

$$R_{VNETUP} = (M_{OT}/(2*x)) - (W_p/4) + (E_v/4) = \boxed{0.0} \text{ LBS. No Uplift}$$

Force Summary Per Corner:

Component Anchorage:

$$R_{HNET} = \boxed{223.2} \text{ LBS.}$$

$$R_{VNETUP} = \boxed{0.0} \text{ LBS.}$$

Anchors Embedded in Concrete or CMU:

$$1.3 * R_p * R_{HNET} = \boxed{725.3} \text{ LBS.}$$

$$1.3 * R_p * R_{VNETUP} = \boxed{0.0} \text{ LBS.}$$