


ENGINEERED PRODUCTS

Accessory [AS] - N7 Extended Vent Cap Unit Type (UT) - RT, Natural Vent Rooftop Unit Capacity (CA) - (10-12) (100-1,200 mBTU)

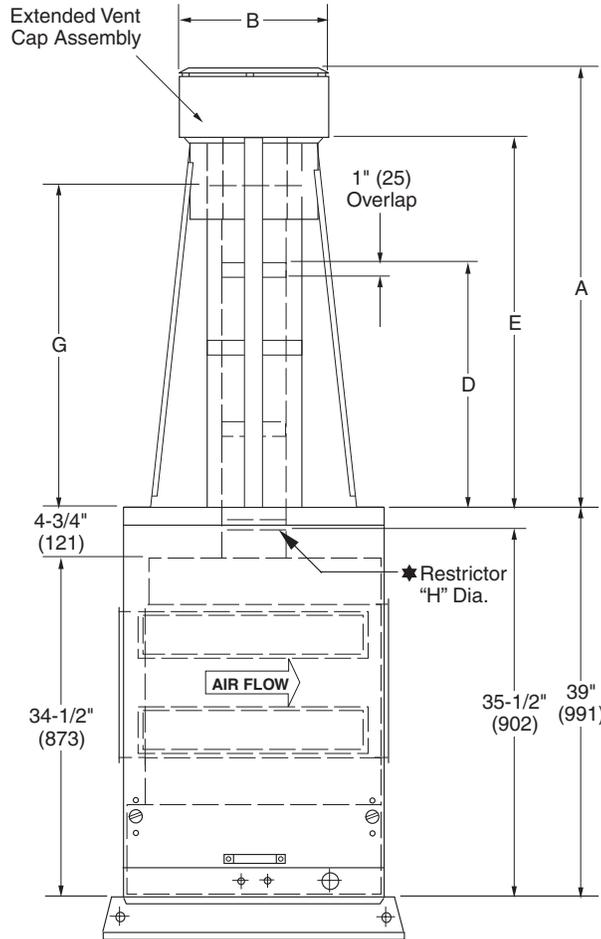

D4460

Dimensions Are In Inches
(Dimensions In Parenthesis Are In Millimeters)

Unit Size	A	B	D	E	G	★ H Dia.
100	38-1/2" (978)	12" (305)	28-1/2" (724)	34" (864)	30-1/8" (765)	1-1/8" (28)
150	42" (1067)	21-1/2" (546)	27-1/32" (686)	34-3/8" (873)	29-5/8" (752)	1-3/4" (44)
200/250	42" (1067)	23-1/2" (597)	27-1/32" (686)	34-3/8" (873)	29-3/4" (752)	2" (57)
300/350/400	43-1/2" (1079)	26" (660)	27-1/32" (686)	35-3/8" (898)	29-3/4" (756)	2-1/2" (63)

★ The restrictor is located inside the flue stack (Also see dwg. D4461 for reference)

Refer to reverse side for assembly instructions.




260 NORTH ELM ST. WESTFIELD, MA 01085
(413) 564-5540 • FAX: (413) 562-5311

www.sterlinghvac.com A MESTEK COMPANY


Project: _____

Unit Tag: _____

Extended Vent Cap Assembly Instructions

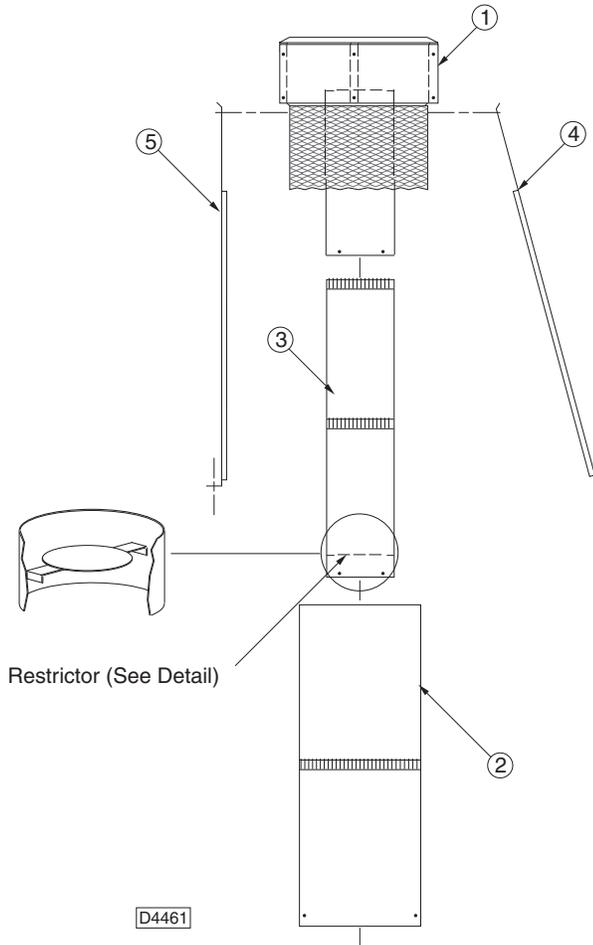

- ① Vent Cap Assembly
- ② Combustion Air Stack Sub-Assembly
- ③ Flue Stack Sub-Assembly
- * ④ Side Support Bracket (2 Req'd.)
- * ⑤ Front/Rear Support Bracket (2 Req'd.)
- * "Guide Wires" may also be used in lieu of these brackets, insuring extended cap assembly is adequately secured to the unit.

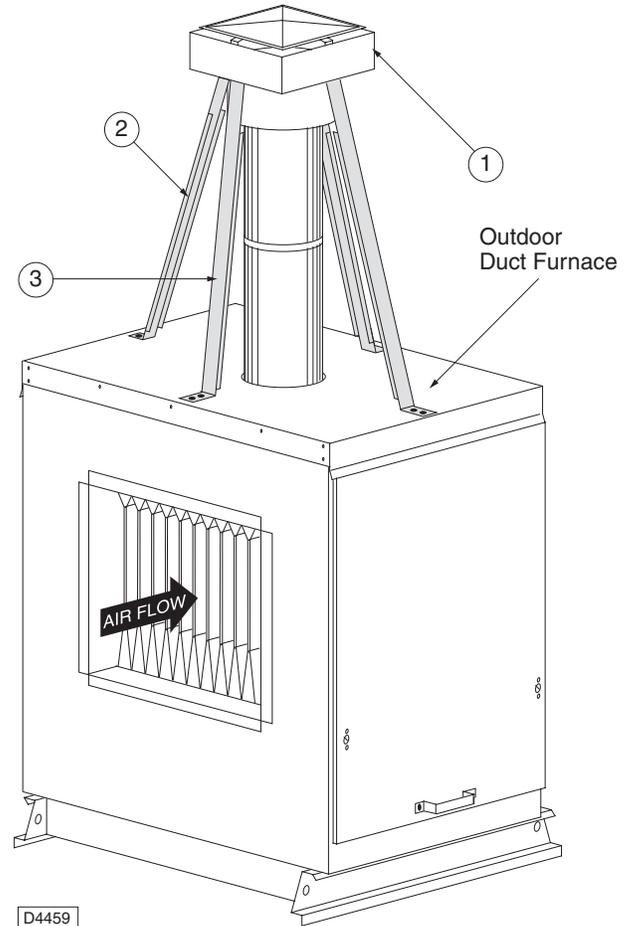

- ① Extended Vent Cap Assembly
- * ② Side Support Brackets
- * ③ Front & Rear Support Brackets
- * "Guide Wires" may also be used in lieu of these brackets, insuring extended cap assembly is adequately secured to the unit.